


To
Pixel
Matrix
Modules





NOTES/KEY:

1. AC Service is shown only to complete diagram and is not provided in CMS Model 500/510 or 520 package.
2. Incoming power to Service Cabinet is 120/240 Single Phase.
3. Secondary side of Main Disconnect shall be #2 AWG or equivalent capacity multiple wires.
4. Secondary side of the thirty 1P-20A Circuit Breakers shall be a minimum #12 AWG conductors.
5. AC on CIP shall be routed to PXDA1-5.

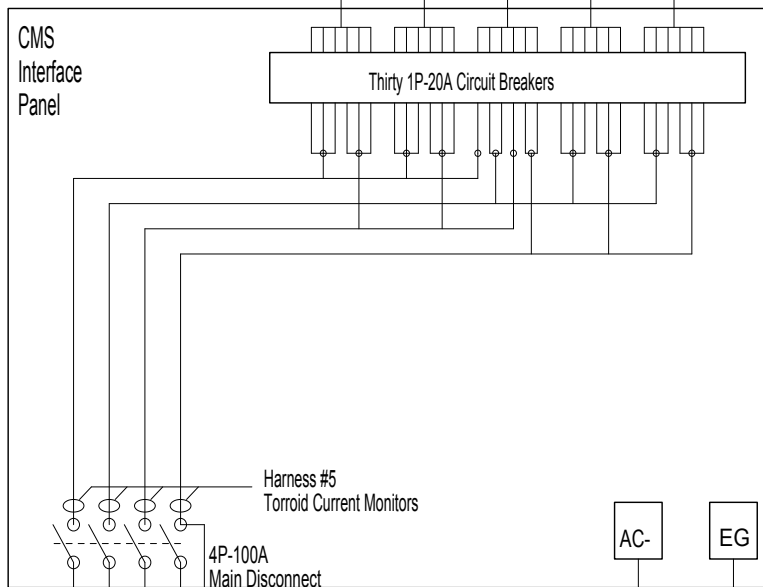

Fan/Temp
Control

PDA #4

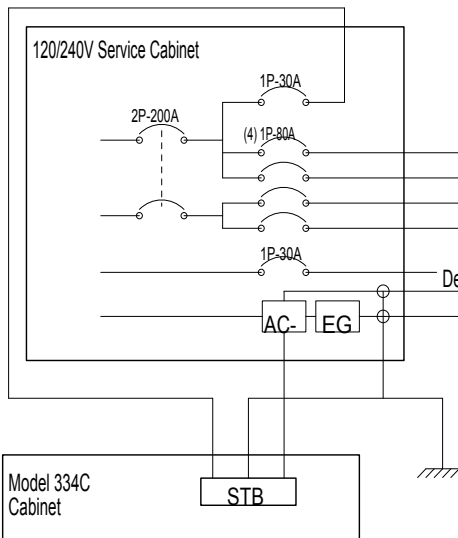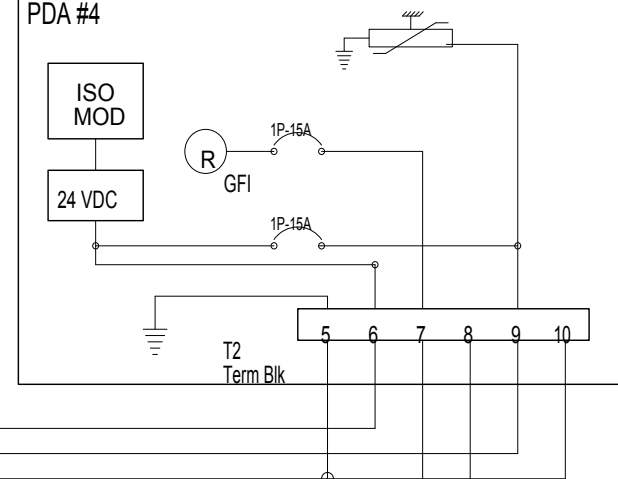

No Scale

MODEL 500/510 or 520 CMS SYSTEM

Title: System Wiring Diagram

Sheet 1 of 1

Date: JULY 1996

Page: 8-7-2